


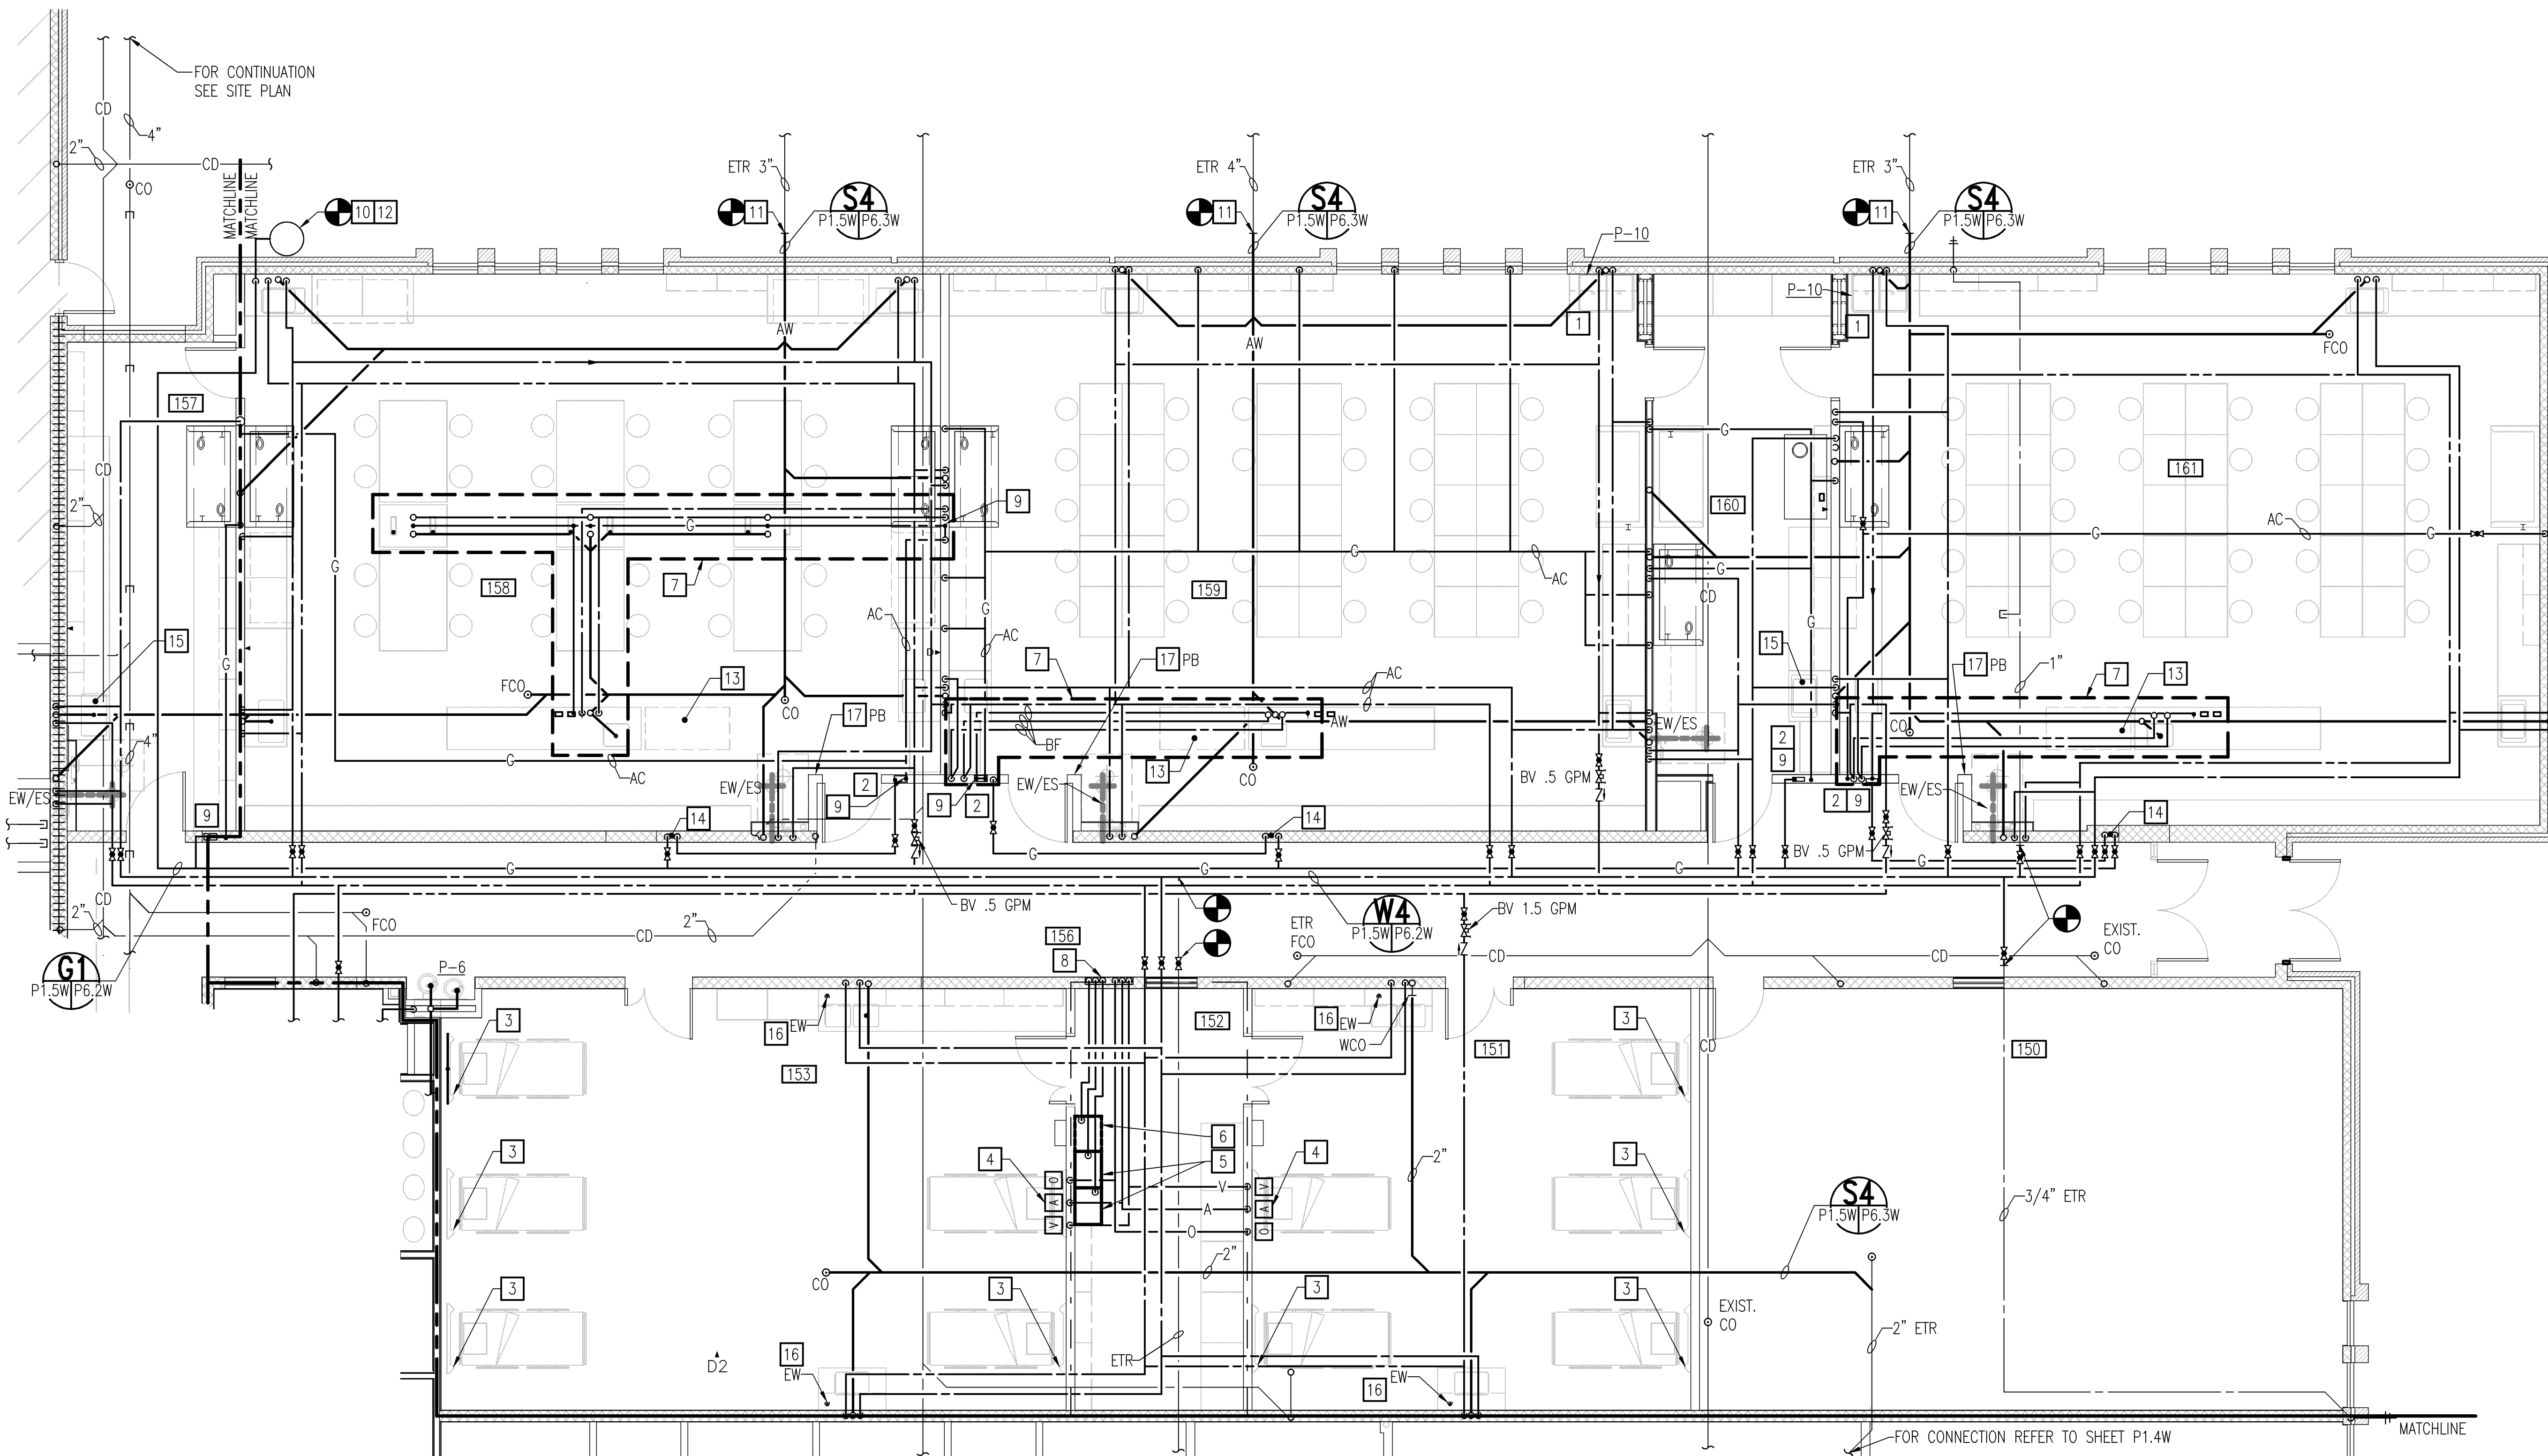

NOTES THIS SHEET

- 1 PROVIDE STAINLESS STEEL SINK WITH TWO FAUCETS AND SPRAY HOSE.
- 2 GAS SHUTOFF VALVE IN HALLWAY.
- 3 HEADWALL WITH SIMULATED SERVICES.
- 4 HEADWALL WITH ACTIVE SERVICES.
- 5 PROVIDE GAS CYLINDER CABINETS. DESIGN BASED ON MATHESON #1178F.
- 6 PROVIDE VACUUM PUMP.
- 7 GAS LINE BELOW FLOOR IN PVC SLEEVE REFER TO DETAIL.
- 8 MEDICAL GAS SHUT OFF AND ALARM PANELS.
- 9 GAS LINE CONDUIT SHALL BE VENTED TO THE OUTDOOR REFER TO DETAIL.
- 10 RELOCATE PROPANE GAS TANK, MAKE CONNECTIONS CONTRACTOR TO PROVIDE FULL TANK AFTER TESTING.
- 11 CONNECT NEW AW PIPE TO EXISTING AW PIPE
- 12 COORDINATE WITH OWNER SERVICE CONTRACT FOR PROPANE REFILL.
- 13 PROVIDE LAB QUALITY DISCONNECTS TO ADA SINK.
- 14 EMERGENCY GAS SHUT OFF SOLENOID VALVE. PROVIDE RECESSED KEYS VALVE BOX.
- 15 PROVIDE HOTWATER ISOLATION VALVE AND 3/8TH TUBING UNDER SINK FOR BOTTLE WASHING MACHINE. DISCHARGE HOSE TO WASTE.
- 16 PROVIDE DECK MOUNTED EYEWASH WITH FLEXIBLE HOSE.
- 17 PROVIDE RED MOMENTARY CONTACT PUSH BUTTON WITH CLEAR COVER AND SIGNAGE READING "EMERGENCY GAS SHUTOFF". PROVIDE CONTROL WIRING AND CONDUIT TO ASSOCIATED SOLENOID VALVE.

ACID WASTE PIPE NOTE:

PROVIDE PLASTIC PIPE APPROVED FOR ACID WASTE DWV BELOW SLAB AND UP THOUGH ROOF FOR ALL WORK RELATED TO LAB SINKS. NEUTRALIZATION TABLETS SHALL BE UTILIZED BY RCC STAFF.

VALVE NOTE:


LOCATE ISOLATION VALVES IN CORRIDOR BETWEEN CEILING CLOUDS FOR ACCESS

SECTION 5
ROOM SCHEDULE

150	GENERAL CLASSROOM
151	NURSING LAB
152	NURSING STORAGE
153	NURSING CLASSROOM/LAB
154	WOMENS
155	JANITOR
156	CORRIDOR
157	CHEM/PHYSICS PREP
158	CHEM/PHYSICS LAB
159	BIOLOGY LAB 1
160	BIOLOGY PREP
161	BIOLOGY LAB 2

SAW CUT NOTE: 7

CONTRACTOR SHALL SAW CUT, REMOVE & PATCH CONCRETE FLOOR AS REQUIRED TO PERFORM WORK INDICATED. PATCH FLOOR TO MATCH ADJACENT EXISTING CONDITIONS. CONTRACTOR SHALL VERIFY PIPE INVERTS PRIOR TO SAW CUTTING.

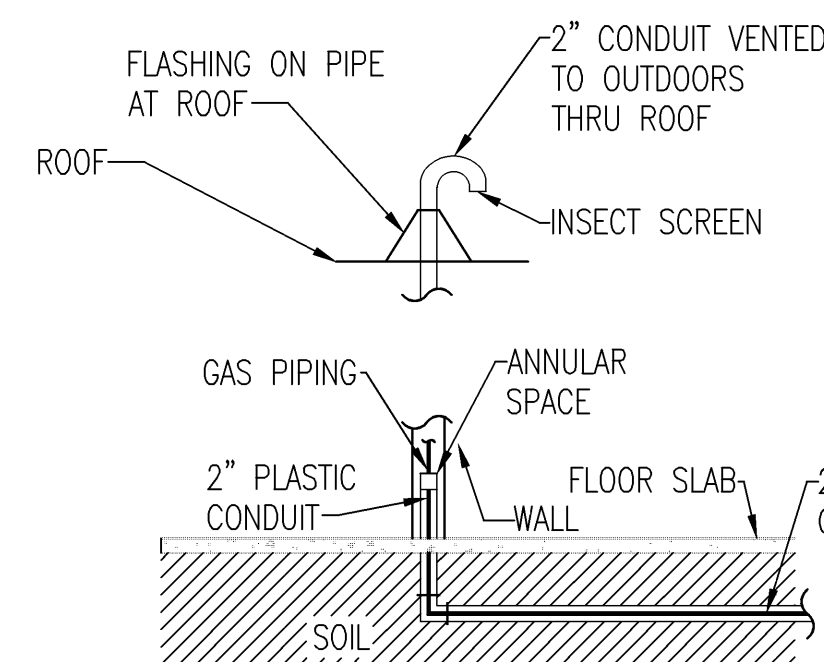

BELOW FLOOR GAS LINE DETAILS

NO SCALE



GRAPHIC SCALES

